

OSP Cabinet Replacement Fans & Alarm Control Boards





"Lucent 2B"

PN # TF-LU2B
48 Volt Replacement Fan for
Lucent 2B Fan Tray

w/ 3 Wire Plug

(Equiv. to KS22501L5A)

NEW Alarm Control Boards are also available,
order # TFC-LU2BC-01,
AT&T PID # ATT.200006513

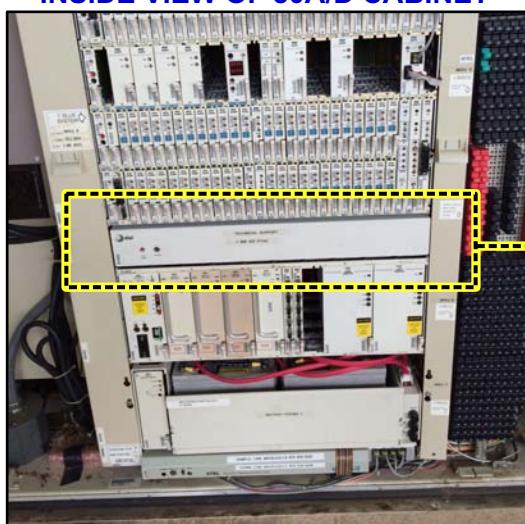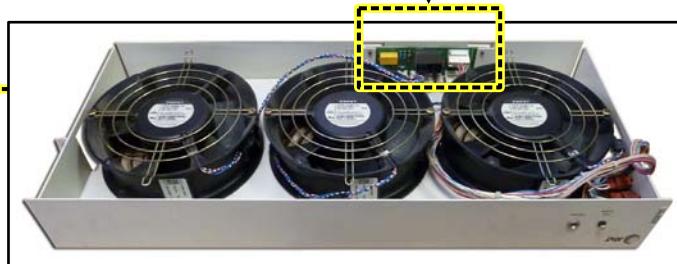

LUCENT 2B FAN TRAY
w/ (3) EXISTING FANS (BOTTOM VIEW)
(fan tray is not included)

Ordering Information:

		AT&T PID #
TF-LU2B	48V Fan for Lucent 2B Fan Tray w/ 3 Wire Plug (Equiv. to KS22501L5A)	ATT.200002996
TFC-LU2BC-01	Alarm Control Board for Lucent 2B & 2C Fan Trays (customer supplied fan trays)	ATT.200006513
TFCS-2BPWRY-01	Power Cable "Y" for Lucent 2B & 2C Fan Trays w/ 1 Male Connector to Female "Y", (1') - (not shown)	ATT.200006909
TFCS-2BRS-08	Remote Sensing Daisy Chain Cable for Lucent 2B & 2C Fan Trays w/ 2 Wires & Connectors, (8') - (not shown)	ATT.200006910

150 Cooper Rd. (F-15)
W. Berlin, NJ 08091

www.tagcords.com

Telephone: (856) 753-8585
Fax : (856) 768-7645

Telecom Assistance Group