

OSP Cabinet Replacement Fans


"DMS-100 OPM BFU / DMS-1 URBAN"

(Not for use in Nortel Access Node Fan Trays)

PN # TF-DMS06

48V Replacement Fan for
Booster Fan Unit (BFU) found in
DMS-100 OPM Cabinets

w/ Power Prongs,
Unterminated Tach Lead
& (1) Butt Splice

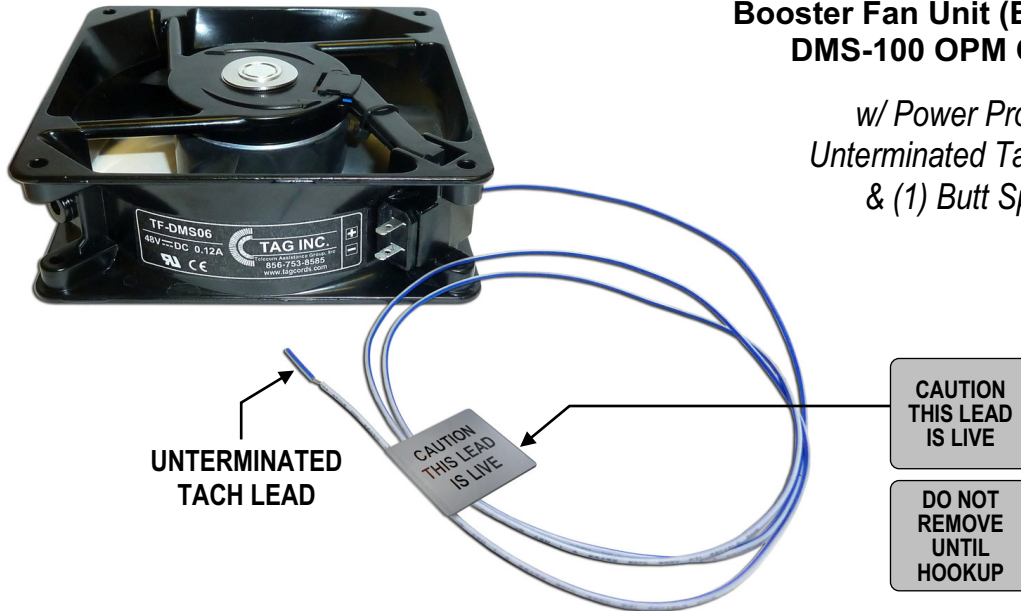

DMS-100 OPM CABINET BOOSTER FAN UNIT (BFU) w/ EXISTING FANS



Also used in DMS-1
URBAN EMC RT BAY
(**NT4A44AA** fan unit)

Ordering Information:

TF-DMS06 **48V Fan for Booster Fan Unit (BFU)**
found in **DMS-100 OPM Cabinets**
w/ Power Prongs, Unterminated Tach Lead & (1) Butt Splice
(also used in DMS-1 URBAN EMC RT BAY (**NT4A44AA** fan unit))

Call for Pricing

150 Cooper Rd. (F-15)
W. Berlin, NJ 08091

www.tagcords.com

Telephone: (856) 753-8585
Fax : (856) 768-7645

Telecom Assistance Group